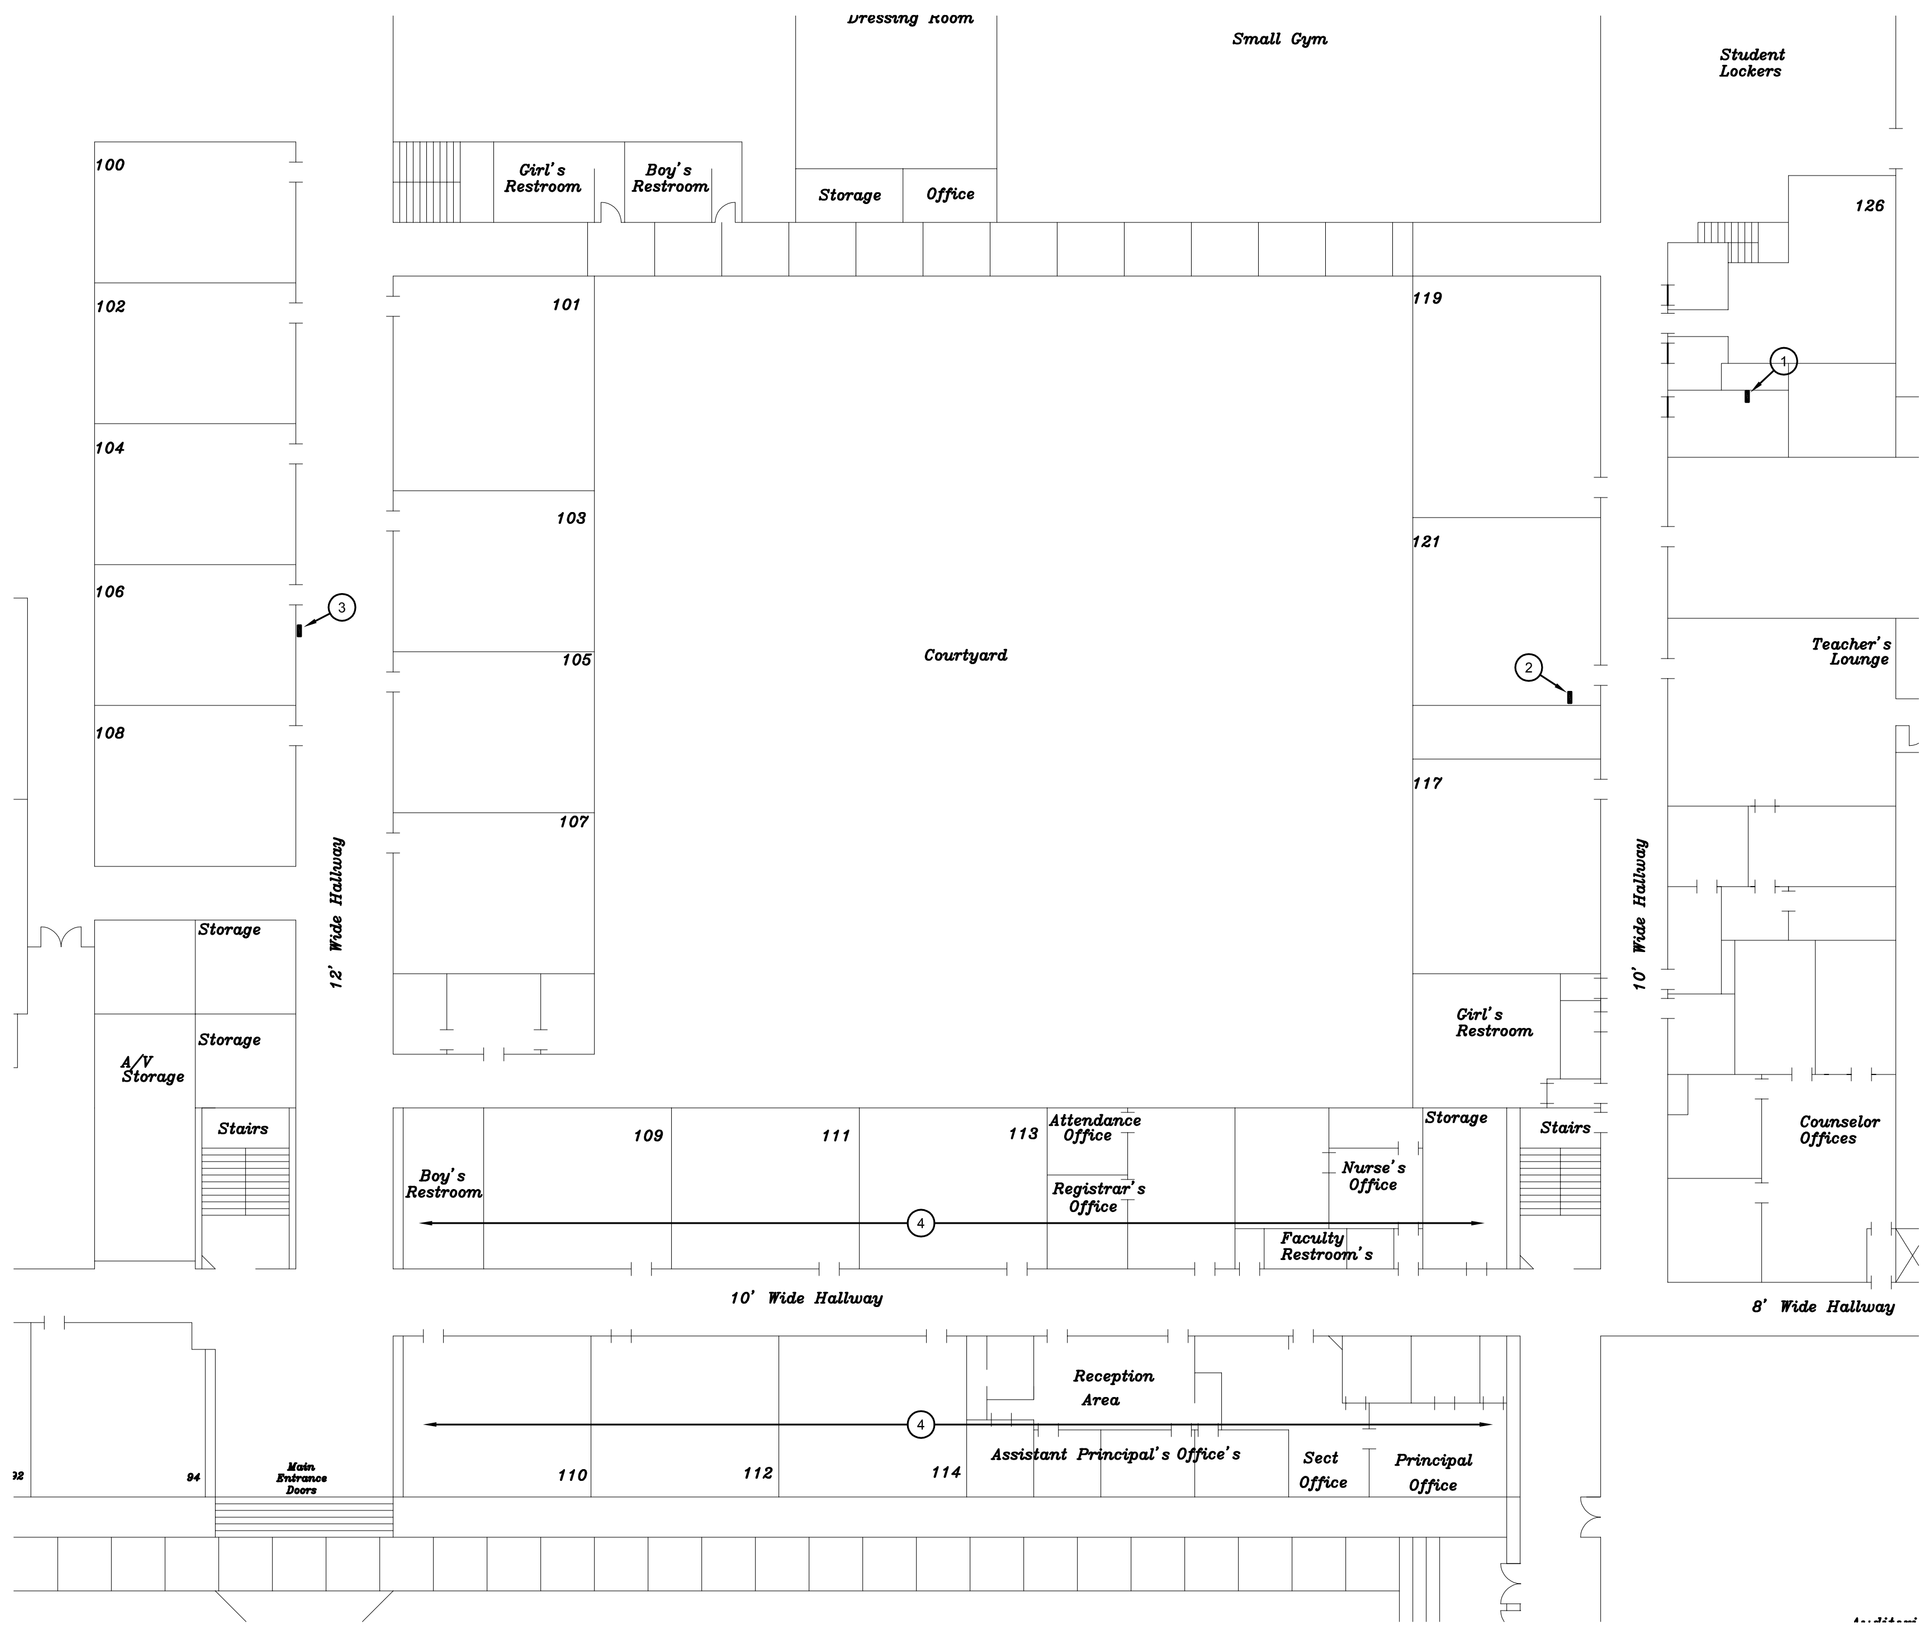

PHASE IV- PARTIAL EXISTING FIRST FLOOR PLAN - POWER

SCALE: 1/16" = 1'-0"

GENERAL NOTES:

A. VERIFY EXACT MAIN BUS AMP RATING, VOLTAGE, BRANCH BREAKER QUANTITY SIZE AND CONFIGURATION AND LOCATION OF ALL EXISTING ELECTRICAL PANELS TO BE REPLACED PRIOR TO SUBMITTAL PHASE.

KEYED NOTES:

1. EXISTING RECESSED 120/208V, 100AMP, 3Ø, 30 BREAKER PANELBOARD IN ROOM 124B TO BE REMOVED AND REPLACED WITH NEW SQUARE D PANEL. VERIFY EXACT LOCATION ON SITE. RECONNECT ALL EXISTING FEEDER AND BRANCH CIRCUITS TO NEW PANEL.
2. EXISTING RECESSED 120/208V, 200AMP, 3Ø, 42 BREAKER PANELBOARD IN ROOM 119 CLOSET TO BE REMOVED AND REPLACED WITH NEW SQUARE D PANEL. VERIFY EXACT LOCATION ON SITE. RECONNECT ALL EXISTING FEEDER AND BRANCH CIRCUITS TO NEW PANEL.
3. EXISTING RECESSED 120/208V, 3Ø, 30 BREAKER PANELBOARD TO BE REMOVED AND REPLACED WITH NEW SQUARE D PANEL. VERIFY EXACT LOCATION ON SITE. RECONNECT ALL EXISTING FEEDER AND BRANCH CIRCUITS TO NEW PANEL.
4. NO WORK IN THIS AREA.

ChapmanHarvey
ARCHITECTS, INC.
612 Broadway
Lubbock, Texas 79401
architect@chapmanharvey.com
(806) 749-1153
FAX (806) 749-1866

Plainview ISD
High School Reno. & Additions
1501 Quincy Avenue
Plainview, Texas 79072

This drawing and all prints of it are the property of Chapman Harvey Architects, Inc. Prints are to be returned to Chapman Harvey Architects, Inc. upon completion of use for which they were issued. Reproductions of these drawings without the written consent of Chapman Harvey Architects, Inc. is not permitted, and Chapman Harvey Architects, Inc. retains all common law and statutory and other reserved rights, including the copyright.

date: 08.22.11
job: 1029
revisions:
1
2



KEYPLAN

08.22.11
STATE OF TEXAS
MICHAEL T. STRAHAN
84881
LICENSED PROFESSIONAL ENGINEER

BSA Consulting Engineers, PLLC
TEXAS FIRM REGISTRATION NO. F-4415
Electrical & Mechanical Consulting Engineers
14302 South Slide Road
Lubbock, TX 79424
Phone: 806.780.7475
Fax: 806.780.0129

© 2011 CHAPMAN HARVEY ARCHITECTS, INC.
UNAUTHORIZED DUPLICATION PROHIBITED.

sheet
E408A
of 2

one inch